


LEGEND	
SYMBOLS	DESCRIPTION
	6" HIGH DENSITY POLYETHYLENE (HDPE) WATER MAIN DIVERSION PIPE
	6" HIGH DENSITY POLYETHYLENE (HDPE) WATER MAIN TO BE ABANDONED
	LEGACY MAINS TO BE ABANDONED
	4" PVC WELL WATER PIPE IDENTIFIED ON SITE TO BE CUT AND RE-ROUTED OUTSIDE OF FOUNDATION FOOTPRINT
	ADDITIONAL WELL WATER PIPES

- NOTES
1. ALL SERVICES IDENTIFIED ARE LOCATED AS ACQUIRITELY AS POSSIBLE WHERE THEY HAVE BEEN PHYSICALLY ENGINEERED.
 2. SERVICES IDENTIFIED BY THIRD PARTIES ARE LOCATED AS INFORMED BY THOSE THIRD PARTIES.
 3. DIVERSION AND ABANDONMENT OF SERVICES AS AGREED WITH SERVICE PROVIDERS.
 4. 5# ADDITIONAL 4" PVC PIPES ARE KNOWN TO PASS THROUGH THE AREA IN OR ADJACENT TO THE SITE. THESE SHALL BE SHUT OFF AND REDIRECTED AS AGREED WITH THE MINISTRY OF PUBLIC WORKS.
 5. FIRE HYDRANT OUTSIDE OF THE WORKS AREA TO BE ABANDONED.

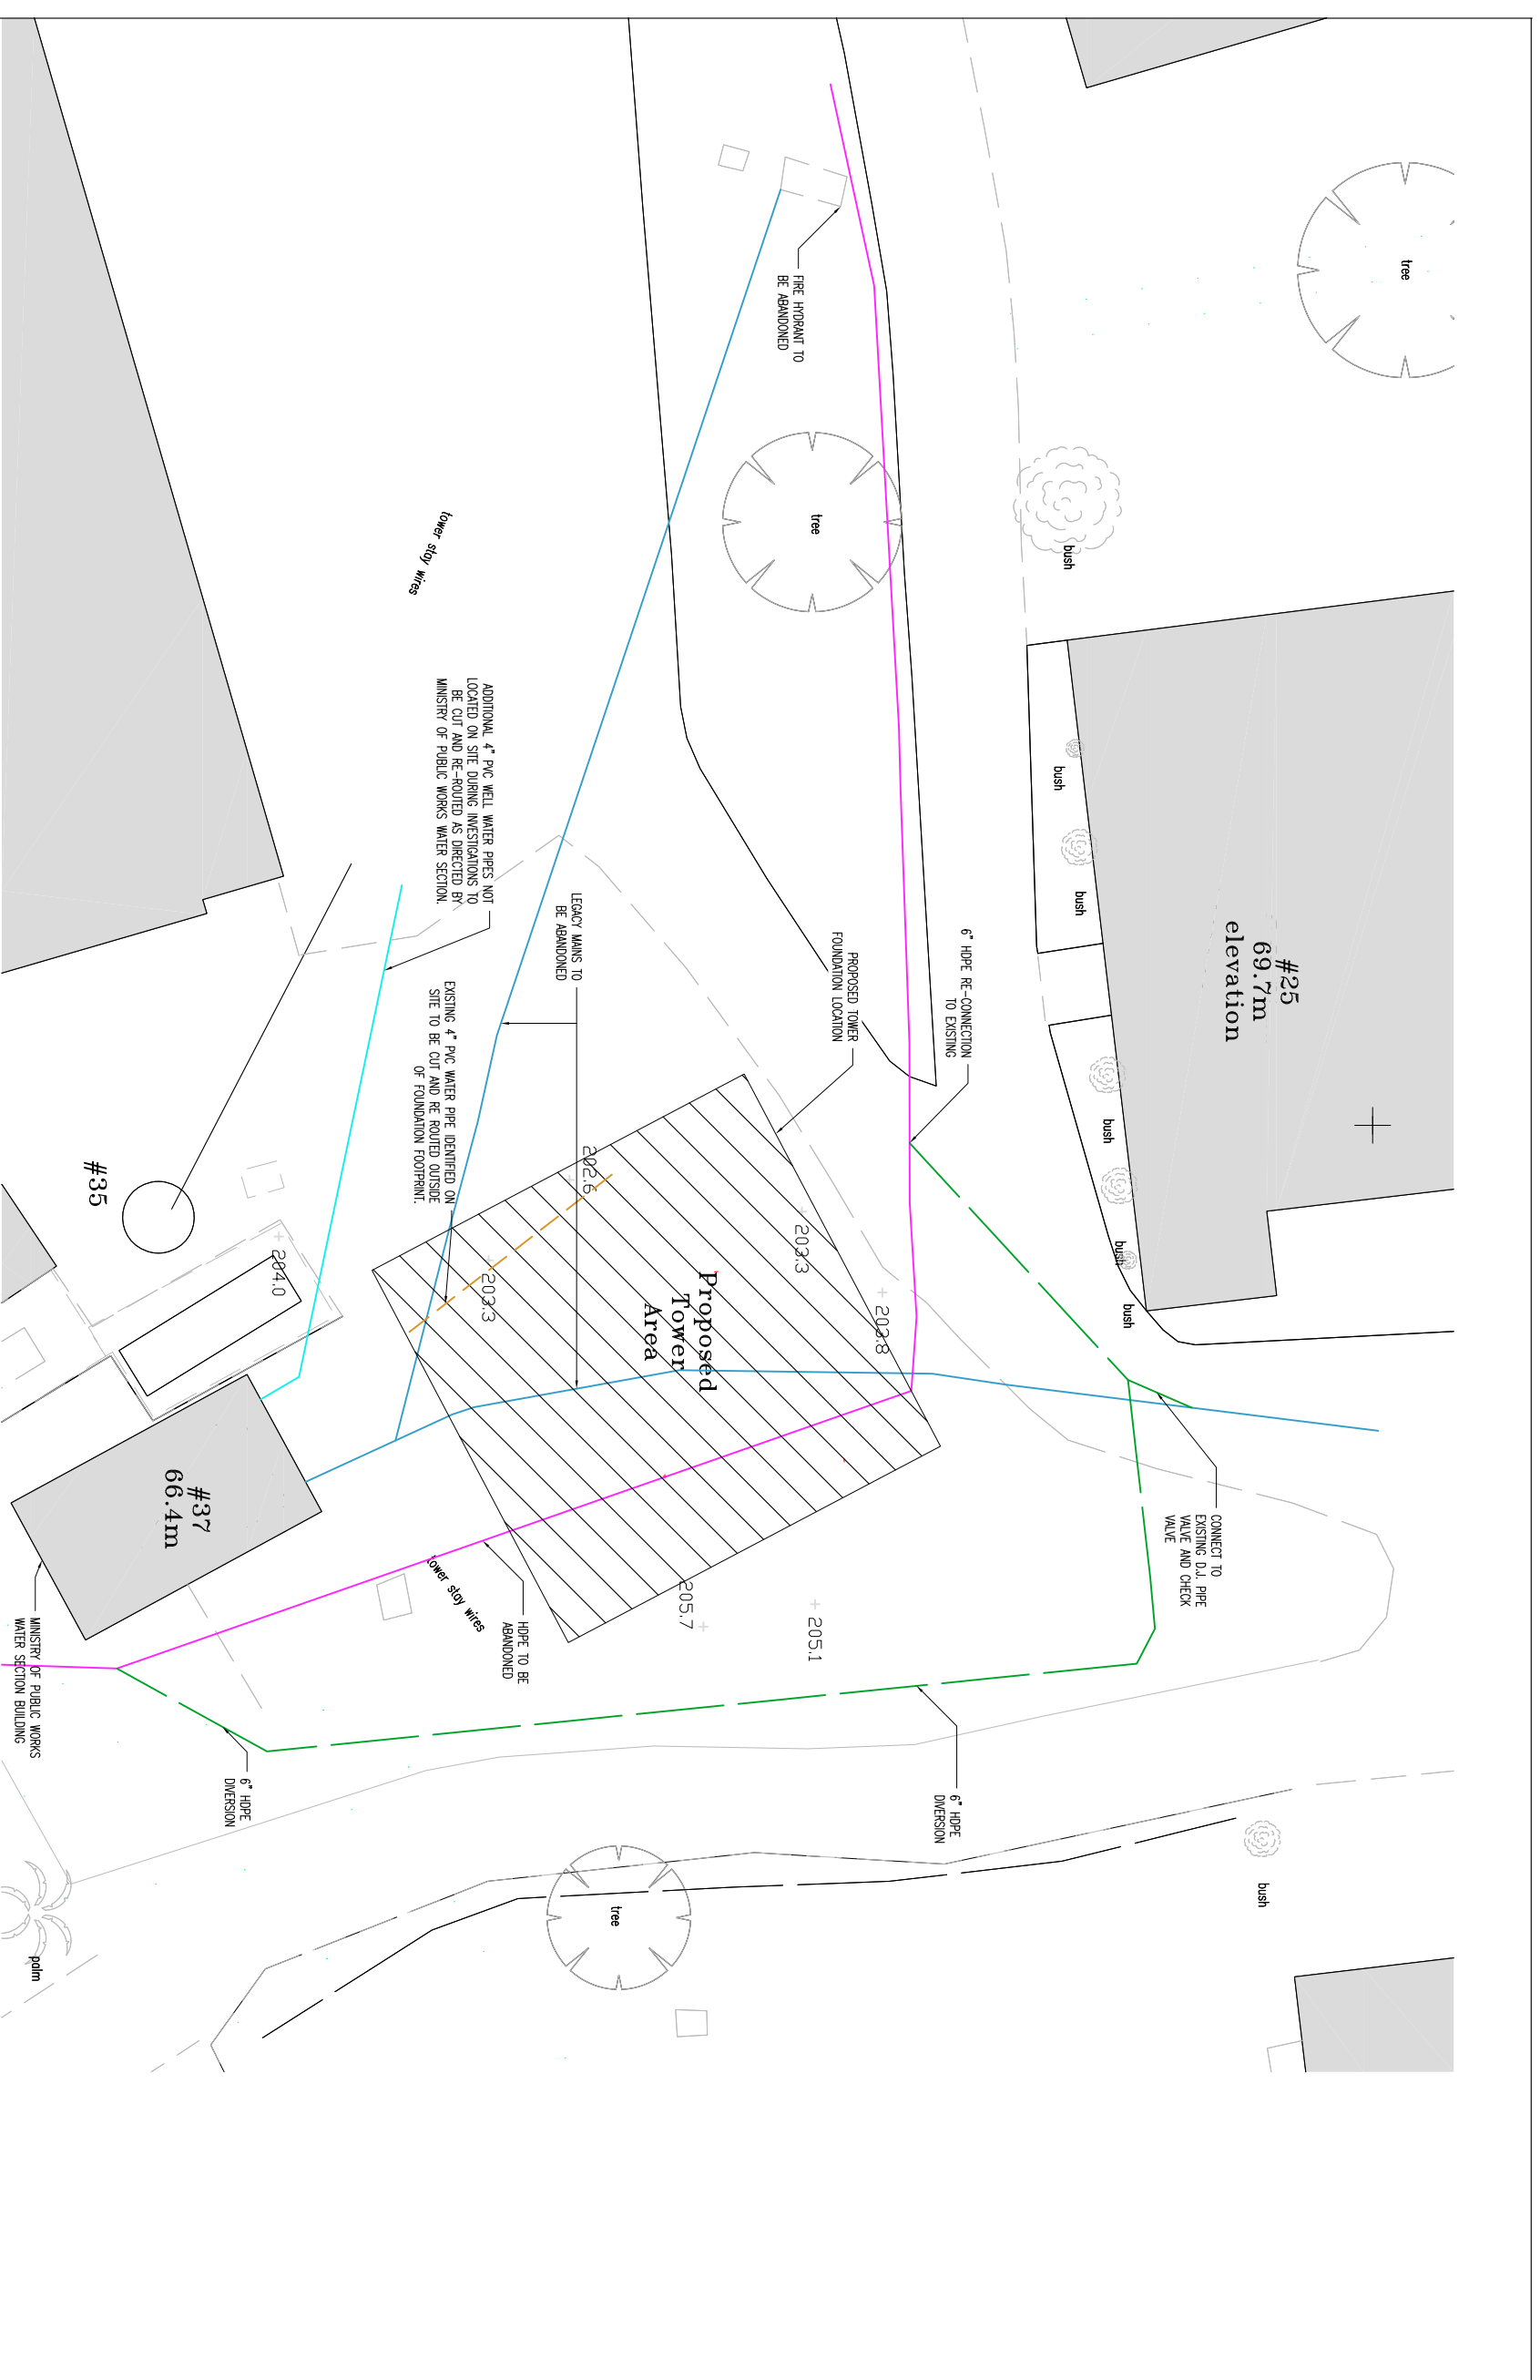

1 SERVICES PLAN
SCALE: 1/8" = 1'-0"

MAY 2020	1	ISSUED FOR PLANNING
FEB. 2019	-	ISSUED FOR INFORMATION
DATE	NO:	REVISION



PROJECT:
PROSPECT TELECOMMUNICATION TOWER REPLACEMENT AND RELOCATION

TITLE:
SERVICES IDENTIFICATION AND RELOCATION

SCALE:	AS SHOWN	JOB NO:	19-103
DRAWN BY:	RDC	DRAWING #:	SE1.0
DATE:	FEB 2020		

DRAWING SCALE SHOWN IS FOR FULL-SIZE DRAWINGS. DIMENSIONS ON SHEETS ARE HALF SCALE SHOWN (1/4"=1'-0" ON 24"x36" SHEET = 1/8"=1'-0" ON 11"x17" SHEET)