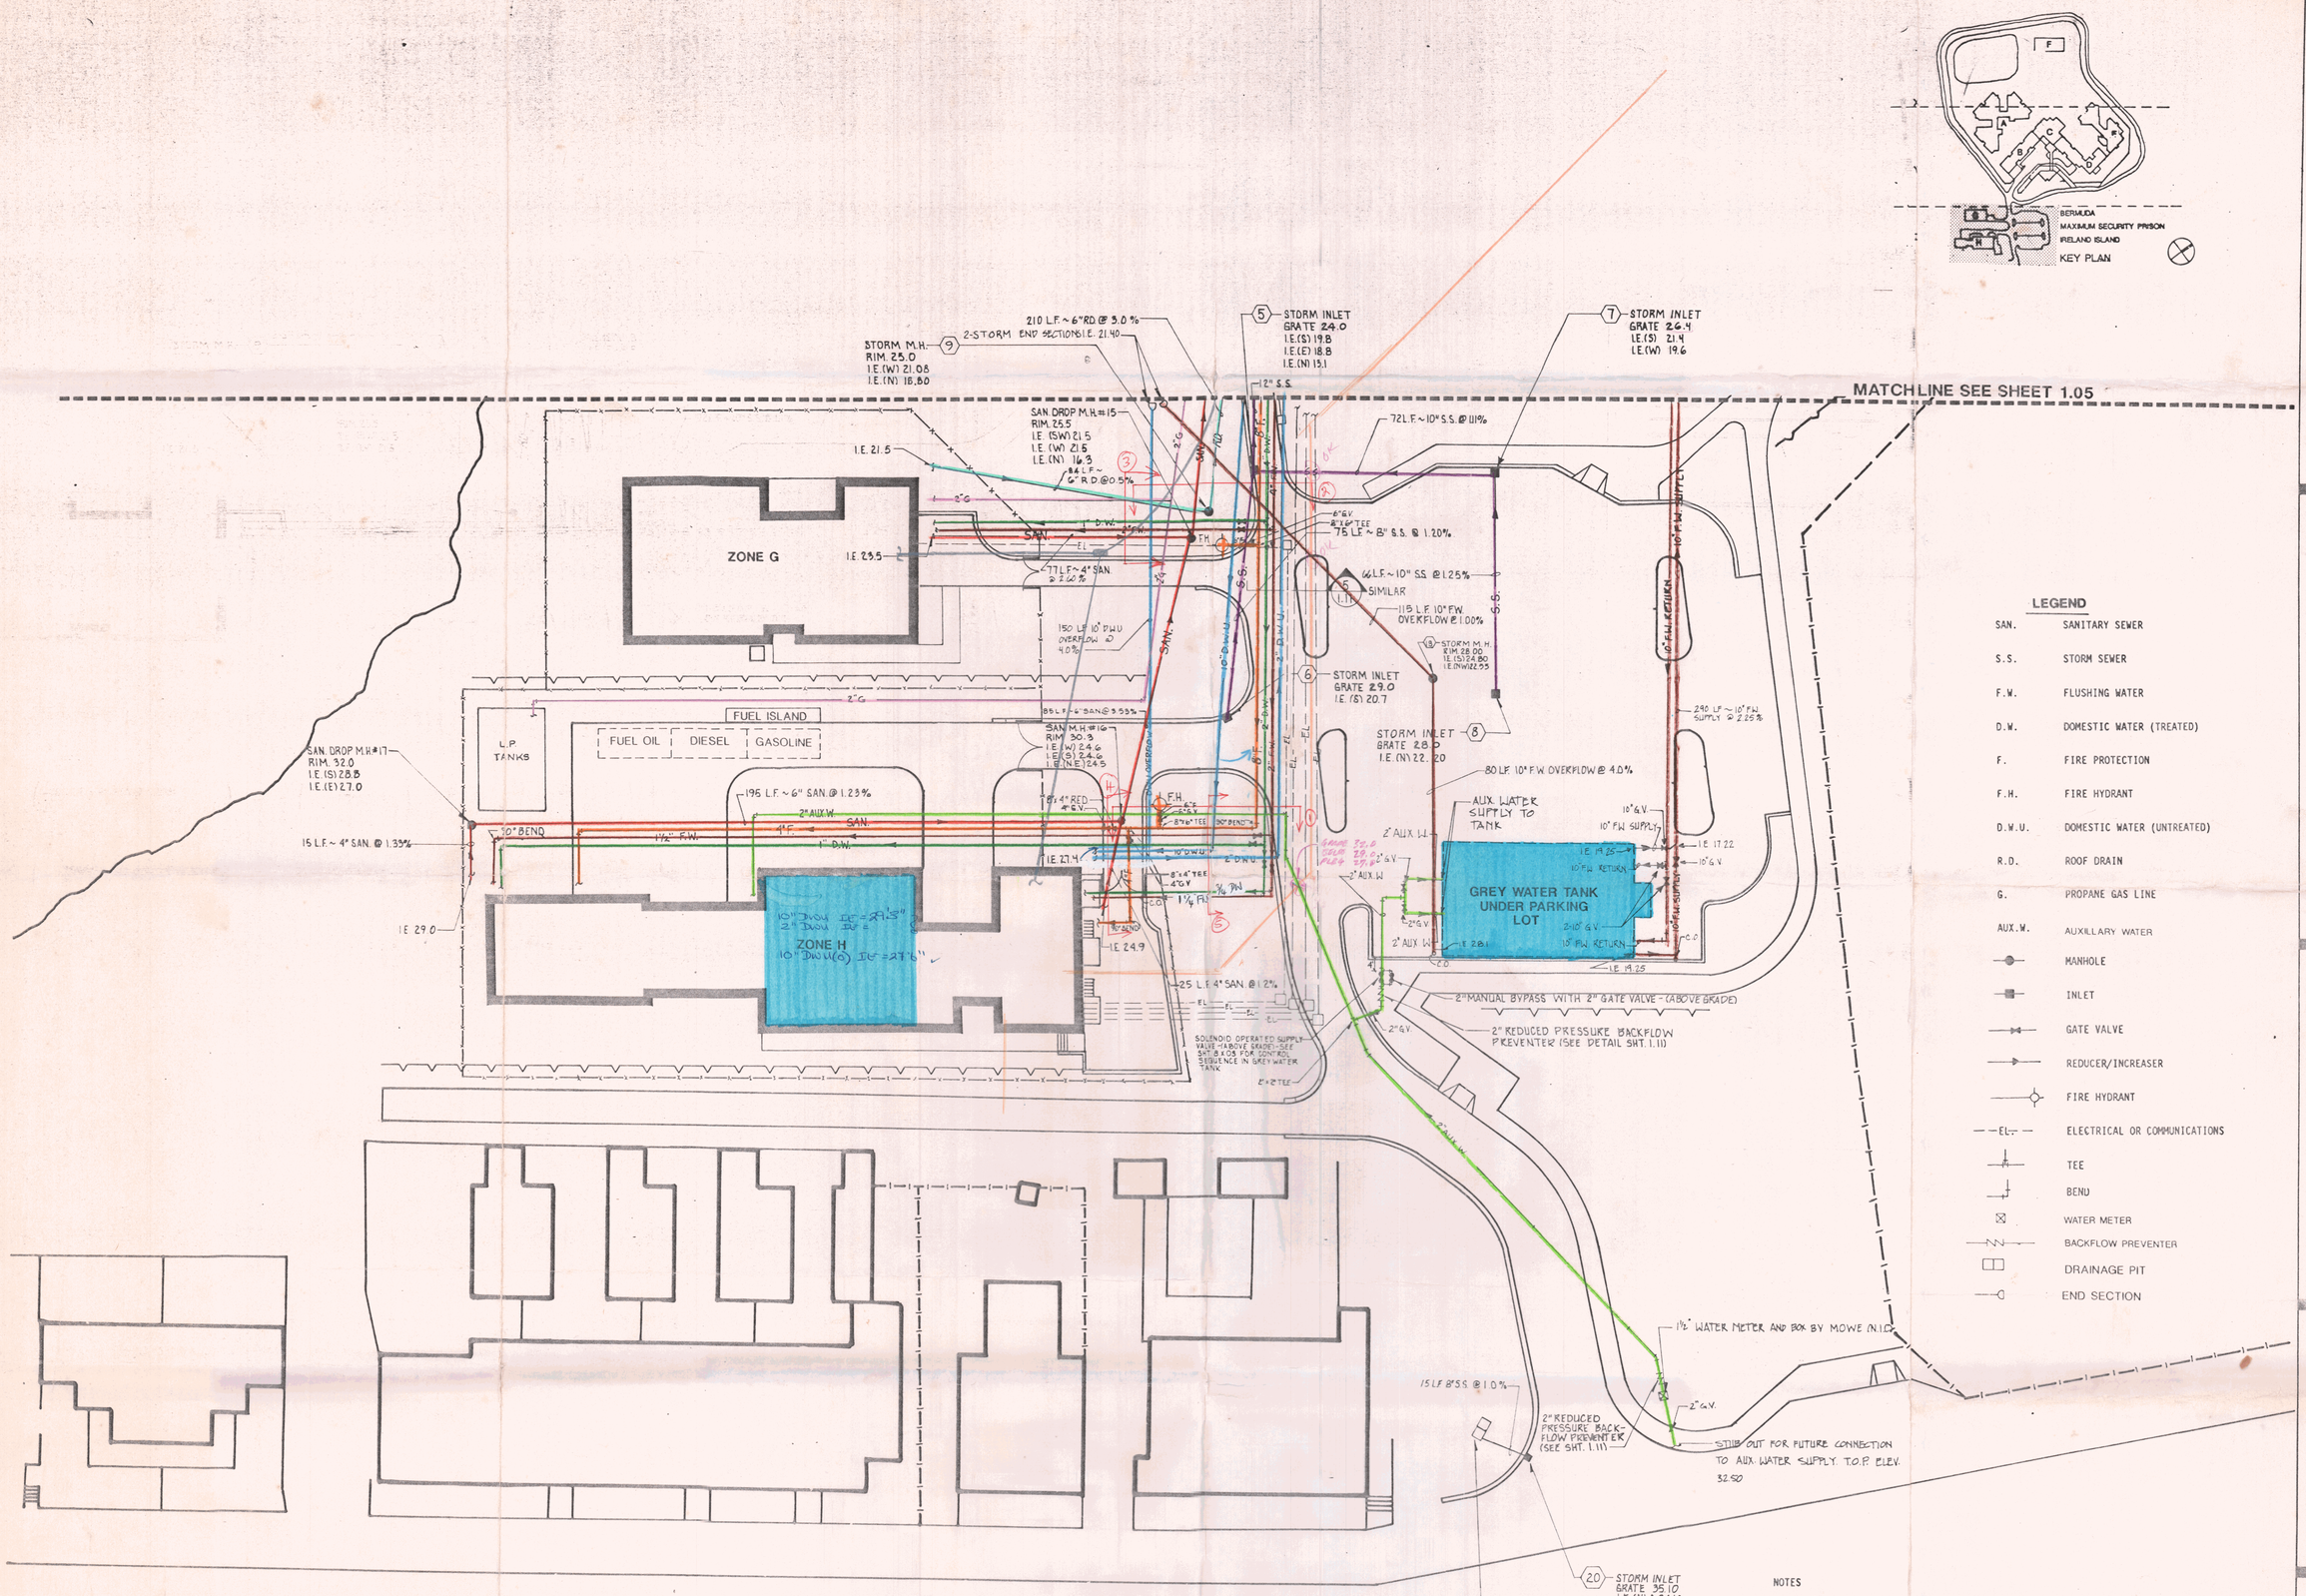

NOTES

1. PROVIDE AIR RELIEF VALVES AT HIGH POINTS IN THE SEWAGE FORCE MAINS, DOMESTIC WATER LINES (TREATED AND UNTREATED), FIRE, AND THE FLUSHING WATER LINES. THESE LINES SHALL BE INSTALLED WITH A MINIMUM OF 2 FEET OF COVER MAXIMUM DEFLECTION IN THE LINES SHALL BE ONE HALF THE MANUFACTURER'S RECOMMENDED DEFLECTION.

2. SEE SHEET 1.11 AND 1.12 FOR DETAILS.

3. LOCATIONS OF ELECTRICAL OR COMMUNICATION LINES ARE APPROXIMATE AND SHOWN FOR REFERENCE ONLY. SEE SHEET 11.X01 FOR ELECTRICAL SITE DISTRIBUTION PLAN.